











# Graduate School of Industrial Administration Emergency Assembly Points



# Graduate School of Industrial Administration Floor A

**Carnegie  
Mellon  
University**

-  Fire Extinguisher
-  Fire Alarm Pull Station
-  AED
-  Area of Refuge
-  Primary Exit - Use Nearest Safe Route  
Secondary Exit - Use Alternate Safe Route
-  Assembly Point
-  Hose Station
-  Fire Alarm Control Panel
-  Fire Annunciator
-  METIS Device




**IN AN EMERGENCY USE THE CLOSEST SAFE EXIT**



**EMERGENCY  
ASSEMBLY  
POINT**

**FREW STREET**

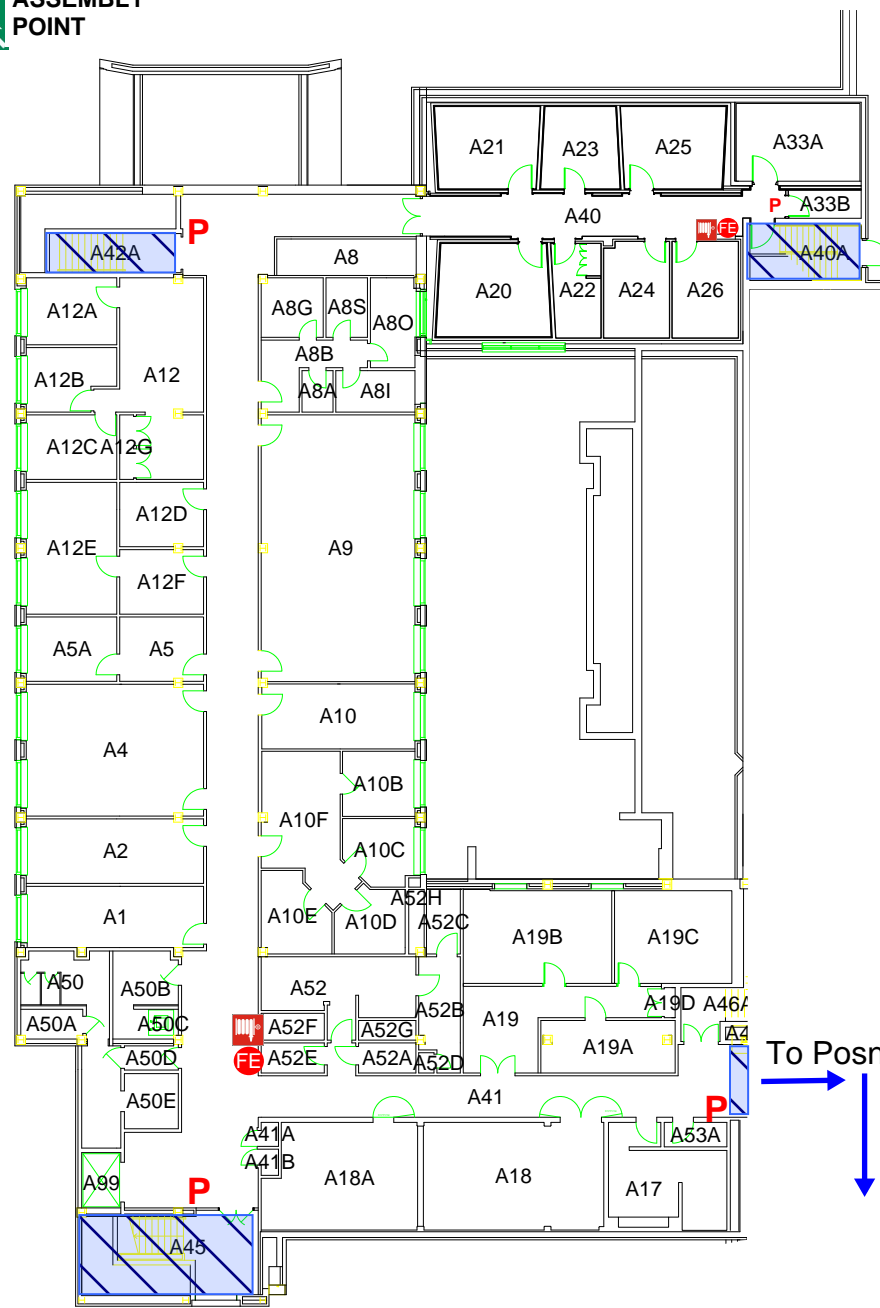

**To Posner Hall**











**TECH STREET**



**EMERGENCY  
ASSEMBLY  
POINT**


# Graduate School of Industrial Administration Floor 1

**Carnegie  
Mellon  
University**

	Fire Extinguisher
	Fire Alarm Pull Station
	AED
	Area of Refuge
	Primary Exit - Use Nearest Safe Route Secondary Exit - Use Alternate Safe Route
	Assembly Point
	Hose Station
	Fire Alarm Control Panel
	Fire Annunciator
	METIS Device





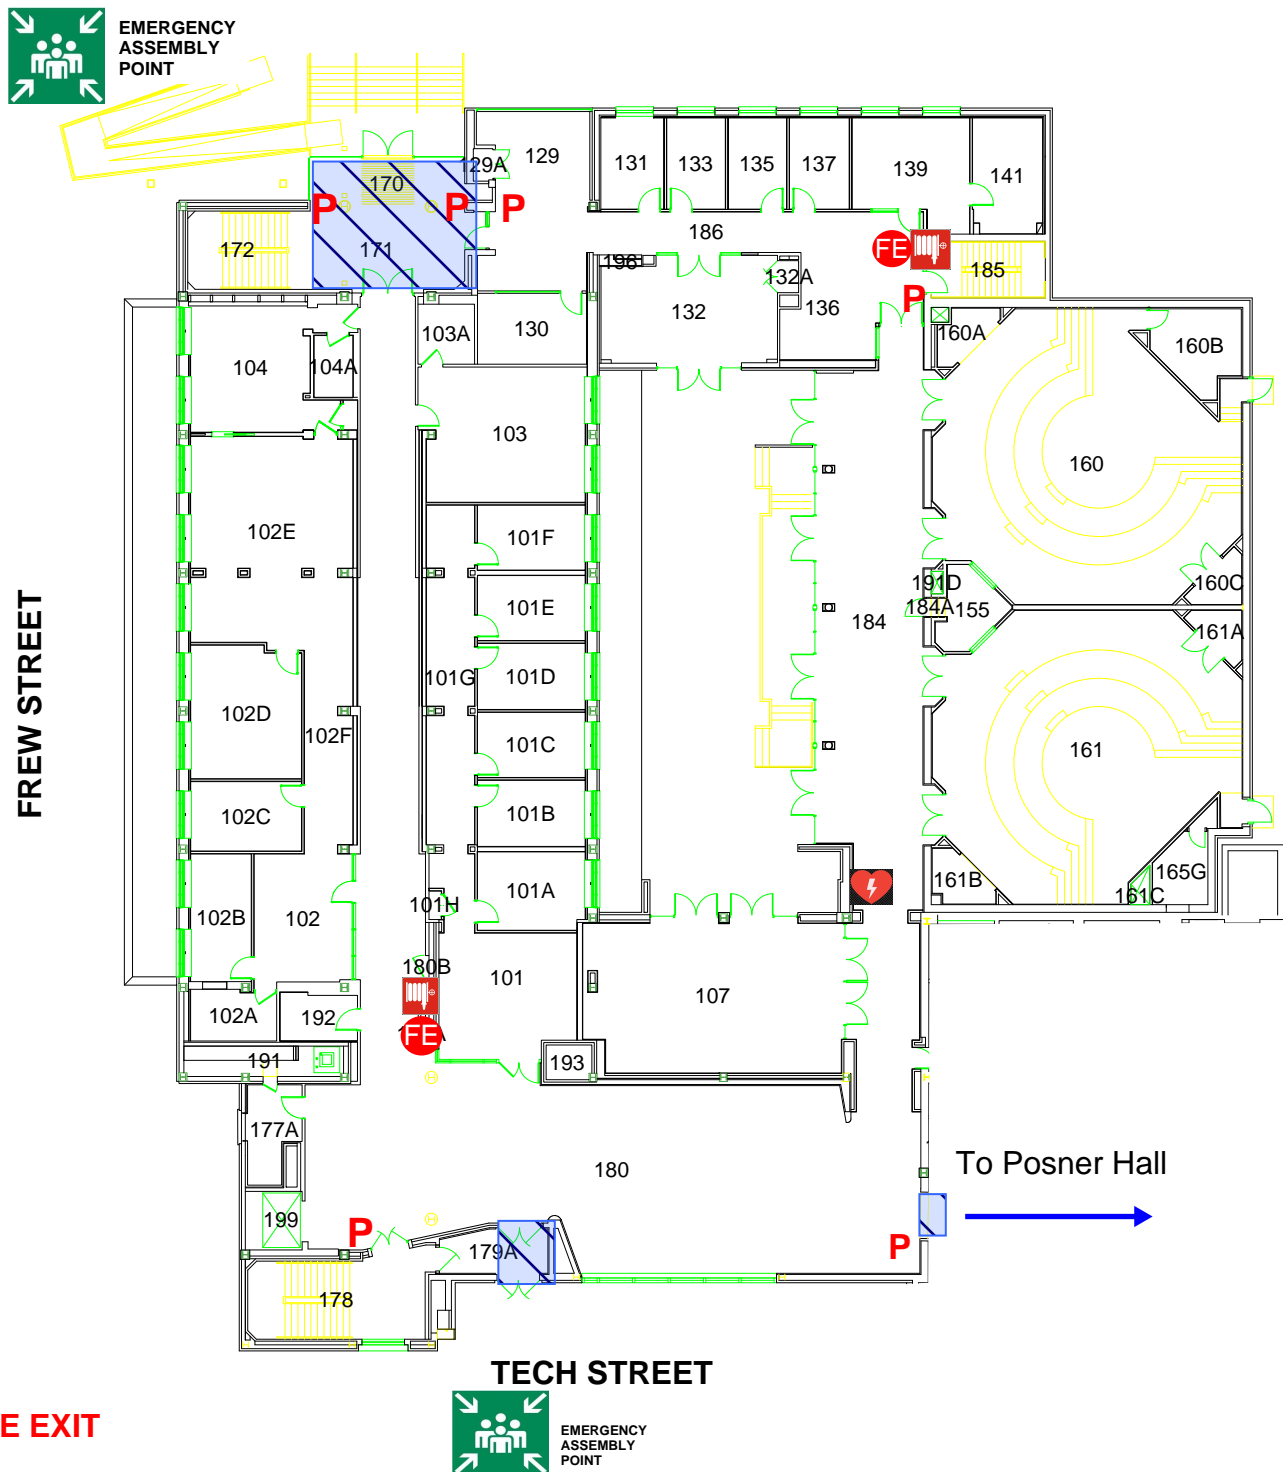







**IN AN EMERGENCY USE THE CLOSEST SAFE EXIT**



# Graduate School of Industrial Administration Floor 2


**Carnegie  
Mellon  
University**

	Fire Extinguisher
	Fire Alarm Pull Station
	AED
	Area of Refuge
	Primary Exit - Use Nearest Safe Route Secondary Exit - Use Alternate Safe Route
	Assembly Point
	Hose Station
	Fire Alarm Control Panel
	Fire Annunciator
	METIS Device



**IN AN EMERGENCY USE THE CLOSEST SAFE EXIT**



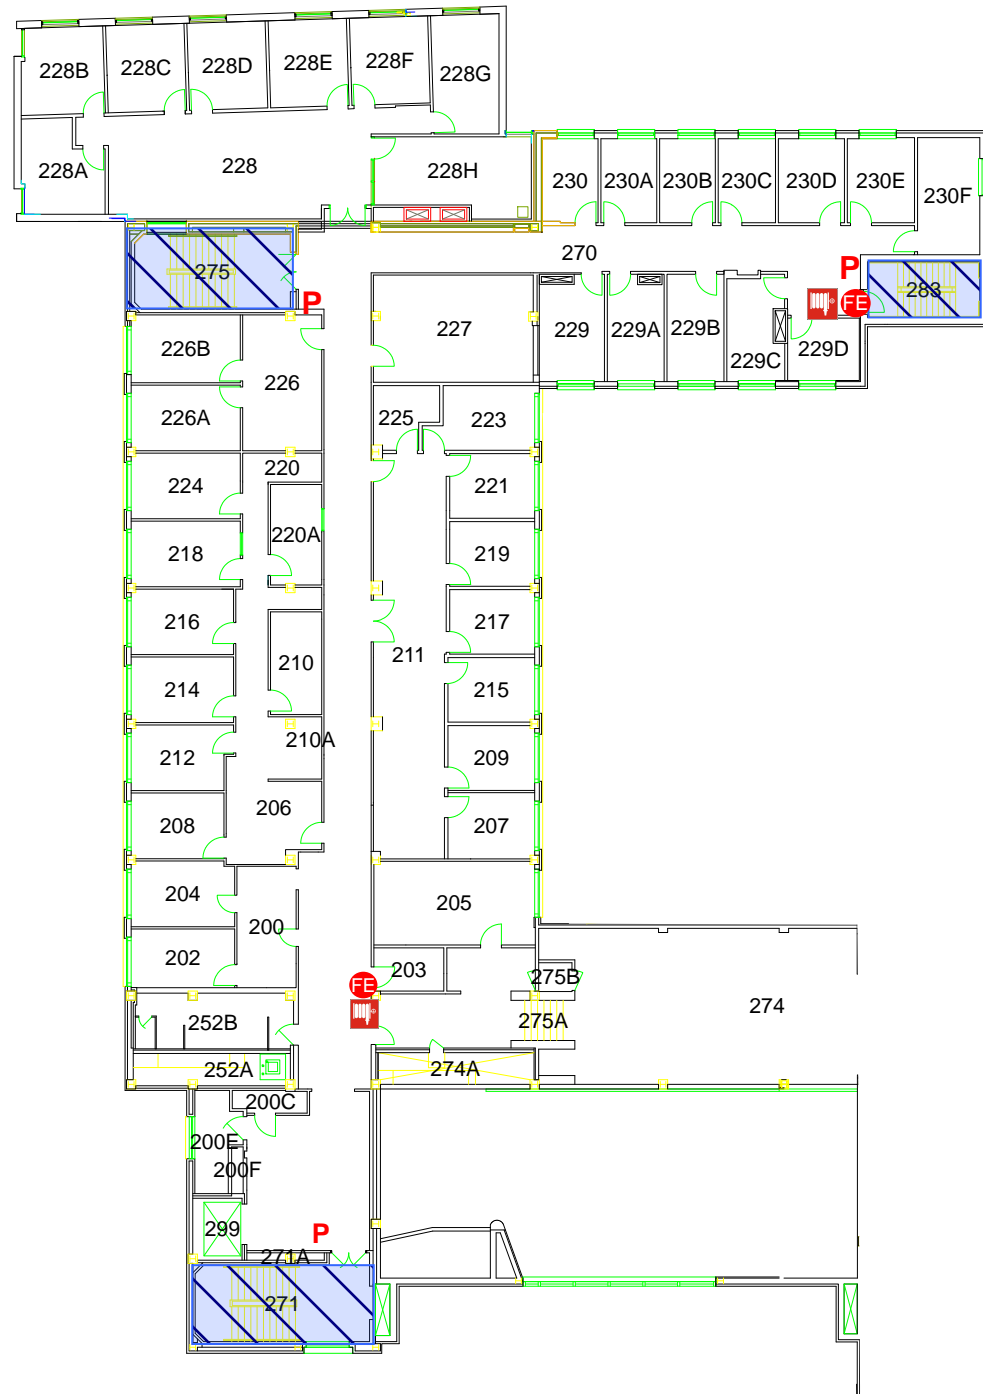







**FREW STREET**



**TECH STREET**

# Graduate School of Industrial Administration Floor 3

**Carnegie  
Mellon  
University**

	Fire Extinguisher
	Fire Alarm Pull Station
	AED
	Area of Refuge
	Primary Exit - Use Nearest Safe Route Secondary Exit - Use Alternate Safe Route
	Assembly Point
	Hose Station
	Fire Alarm Control Panel
	Fire Annunciator
	METIS Device



**IN AN EMERGENCY USE THE CLOSEST SAFE EXIT**

**FREW STREET**













**TECH STREET**



# Graduate School of Industrial Administration Floor 4





Fire Extinguisher

Fire Alarm Pull Station

AED

Area of Refuge

Primary Exit - Use Nearest Safe Route  
Secondary Exit - Use Alternate Safe Route


Assembly Point

Hose Station

Fire Alarm Control Panel

Fire Annunciator



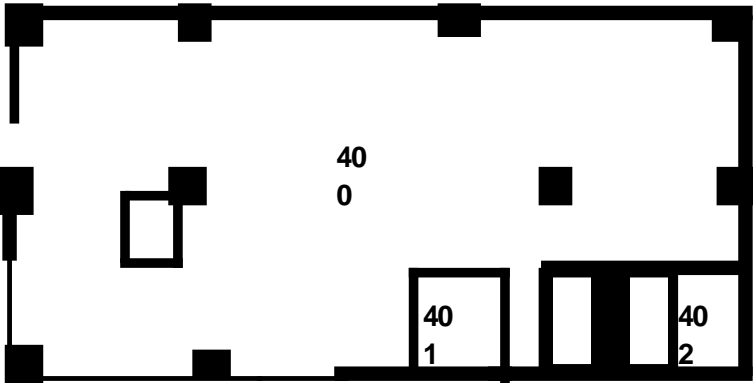







METIS Device



IN AN EMERGENCY USE THE CLOSEST SAFE EXIT

# Graduate School of Industrial Administration Floor 5





Fire Extinguisher

Fire Alarm Pull Station

AED

Area of Refuge

Primary Exit - Use Nearest Safe Route  
Secondary Exit - Use Alternate Safe Route


Assembly Point

Hose Station

FACP Fire Alarm Control Panel

Fire Annunciator

METIS Device

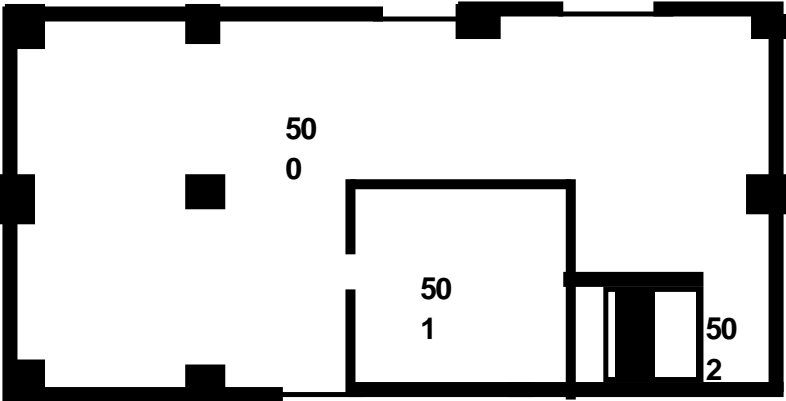

IN AN EMERGENCY USE THE CLOSEST SAFE EXIT